


LINE A	LINE B	JOIN
LOW STD	2,4,5	-
LOW STD	1,3,5	2,4,8

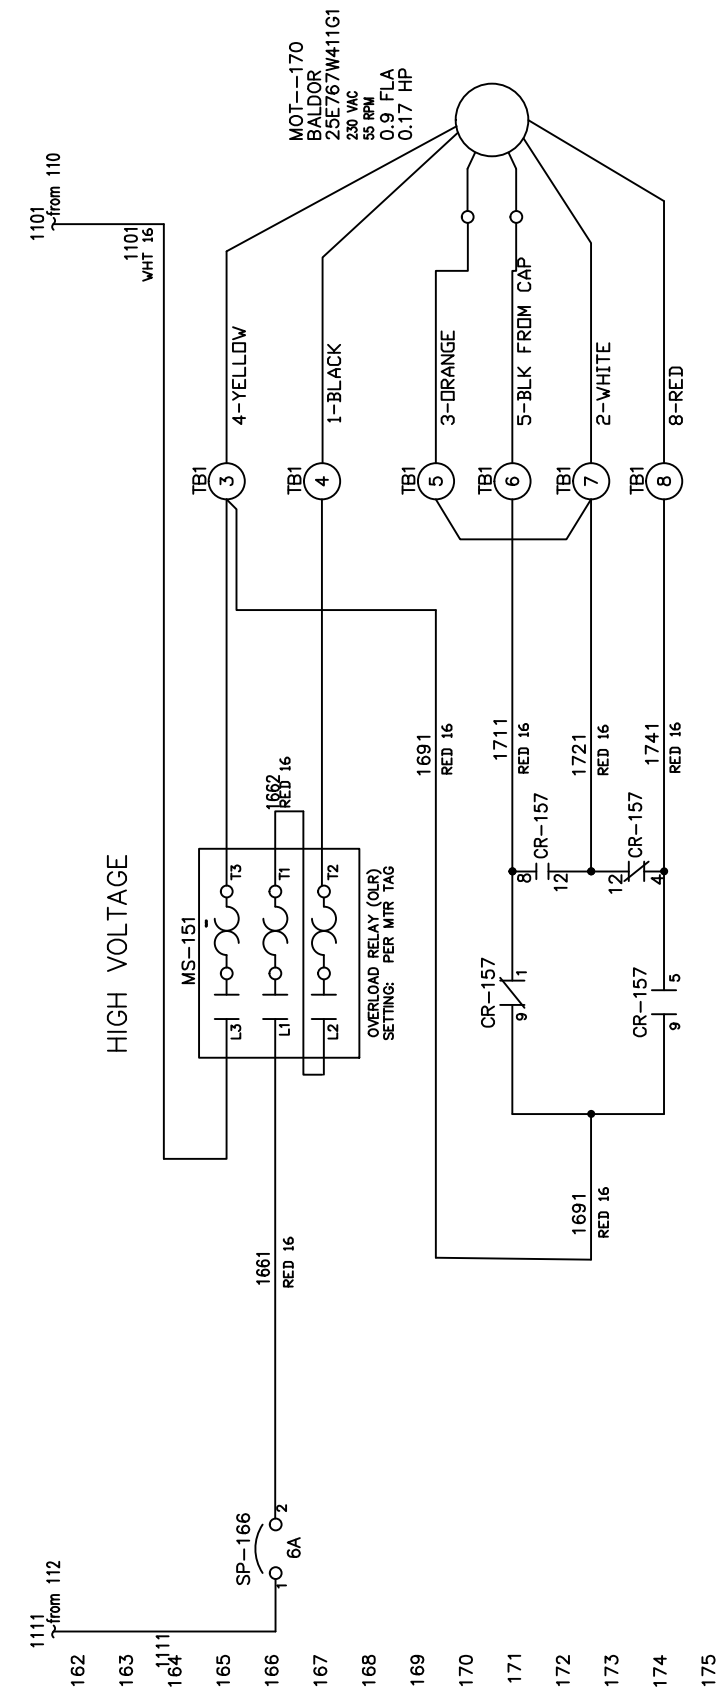

LINE A	LINE B	JOIN
HIGH STD	4,5	2,3,8
HIGH OPD	1	4,8

CUSTOMER: _____ SHEET 1 OF 1
 EQUIP #: _____

REVISIONS
0 10/20/15 CB INITIAL RELEASE
1 07/12/16 CB PREFIX FOR BREAKER DEVICE ID WAS "CB"

THIS DOCUMENT IS BEING TRANSMITTED:	
X	FOR REVIEW AND APPROVAL WORK WILL PROCEED UPON RECEIPT OF APPROVED DOCUMENTS
X	CERTIFIED FOR PRODUCTION ONLY FOR INFORMATION ONLY
X	CERTIFIED 'AS-BUILT' FOR INFORMATION ONLY
SIGNATURE: _____	DATE: _____

NOTE:	
THIS DOCUMENT IS CONFIDENTIAL, AND CONTAINS INFORMATION WHICH IS PROPRIETARY TO SEC. IT IS PROVIDED IN CONFIDENCE AND UPON THE CONDITION THAT NEITHER IT NOR THE INFORMATION CONTAINED IN IT WILL BE COPIED, DISCLOSED, OR USED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF SEC.	
REMOVE ALL BURRS AND SHARP EDGES UNLESS OTHERWISE NOTED	THIRD ANGLE PROJECTION

DO NOT SCALE DWG. ALL DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED TOLERANCES FOR ALL DIMENSIONS UNLESS OTHERWISE SPECIFIED	
MACH. PARTS	STRUCT.
1/X ± 1/8 ± 1/2	.X ± 0.1 ± 0.3
.XX ± 0.01 ± 0.06	.XXX ± 0.005 ± 0.030
ANG. ± 1/2"	± 1"
FILENAME 03936V01	DATE 10/20/15
DRAWN CB	CHECKED
DWG. NO. 10-03936V	DATE APPROVED
REVISION 1	

SENTRY www.sentry-equip.com

B1 1/2 HP 120/230 VAC BALDOR (25E767W411G1)
 ELECTRICAL WIRING DIAGRAM
 SENTRY P/N 4-05796G